



Industrie Service

# CERTIFICATE

(Certificate of conformity with technical requirements in: )  
API STANDARD 607 SEVENTH EDITION, JUNE 2016

Certificate No.:253301 Rev.1

Ref. Test report No.:253300 Rev.1

Name and postal address of manufacturer: Antiwear (Suzhou) Industrial Intelligent Technology Co., Ltd.  
No.988, Yuexiu Road, Fenhui Economic Development Zone, PC: 215200, Suzhou City, Jiangsu Province, P. R. China

We hereby certify that the fire test on below valves have been conducted at the laboratory designated by manufacturer and witnessed by TÜV SÜD inspector according to requirements of API STANDARD 607 SEVENTH EDITION, JUNE 2016. The testing results of valves meet the requirements of API STANDARD 607 SEVENTH EDITION, JUNE 2016.

## 1. Description of Test Valve :

Type of Test Valve	AB-8-T22-150-RF-01-C-R-W-C Ball Valve
Description of Test Valve	Ball Valve
Valve Size (NPS)	8"
Pressure Rating ( Class )	Class 150
Valve Body Material	ASTM A105

## 2. Qualified Range of Valves :

Type	Ball Valves
Description of Valves	Ball Valves
Qualified Sizes ( NPS ) ( according to API 607 Table 3 )	8"and larger
Qualified Pressure Ratings( Class: Lb) ( according to API 607 Table 4 )	Class150,Class 300
Qualified Valve Material ( according to API 607 7.2 )	Ferritic
Remark: the technical data of tested valves see back of this certificate appendix 1.	

This certificate is issued according to API STANDARD 607 SEVENTH EDITION, JUNE 2016, based upon the result of testing report on above mentioned test valve. The additional valve qualification shall be limited on similar valves of same basic design and construction as the test valves and of the same nonmetallic materials as the test valve in the seat-to-closure member seal, seat-to-body seal, stem seal, and body joint and seal according to API STANDARD 607 SEVENTH EDITION, JUNE 2016, Paragraph 7.

Shanghai, July 21, 2022  
(Place, date)

*Chen Guilin*  
**Guilin Chen**  
**TÜV SÜD Industrie Service GmbH**  
Westendstr.199  
80686 München Germany





Industrie Service

## Appendix 1:

Certificate No.:253301 Rev.1

Ref. Test report No.:253300 Rev.1

Name and postal address of manufacturer: **Antiwear (Suzhou) Industrial Intelligent Technology Co., Ltd.**  
**No.988, Yuexiu Road, Fenhui Economic Development Zone, PC: 215200, Suzhou City, Jiangsu Province, P. R. China**

### Technical Data of Valve

1. **Type of Test Valve:** AB-8-T22-150-RF-01-C-R-W-C Ball Valve

2. **Description of Test Valve:** Ball Valve

3. **Details of Valve:**

Valves Size ( NPS ) Material Part Name	8"
Valve Body	ASTM A105
Valve Bonnet	ASTM A105
Ball	ASTM A182 F316
Seat assembly	ASTM A182 F316+RPTFE
Valve Stem	ASTM A564 630
Packing Ring	Flexible Graphite
Pressure Ring	ASTM A376 316
Nut	ASTM A194 2H
Bolt	ASTM A193 B7
Gasket	Flexilble Graphite
Yoke	Q235
Locating Sleeve	PTFE+Flexilble Graphite
Disc Sping	ASTM A564 631
Stuffing Box	ASTM A105
Couping	ASTM A182 F6a
Graphite Ring	Flexilble Graphite
Design Drawing No.:	10020604 VER.1.0

**Shanghai, July 21, 2022**

(Place, date)

TÜV SÜD Industrie Service GmbH  
Shanghai Office  
Floor 3-13, No.151, Heng Tong Road,  
Shanghai 200070 P. R. China

*chen*

**Guilin Chen**

**TÜV SÜD Industrie Service GmbH**

Westendstr.199  
80686 München Germany

Tel.: +86 21 6141-0123  
Fax: + 86 21 6140-8600



## Test Report

**(Valve fire test according to API STANDARD 607 SEVENTH EDITION, JUNE 2016.)**

**Certificate No. : 253301 Rev.1**  
**Test Report No.:253300 Rev.1**

Applicant / Manufacturer: Antiwear (Suzhou) Industrial Intelligent Technology Co., Ltd.

No.988, Yuxiu Road, Fenu Economic Development Zone,

PC: 215200, Suzhou City, Jiangsu Province, P. R. China

Inspection body: TÜV SÜD Industrie Service GmbH

Floor 3-13, No.151, Heng Tong Road, Shanghai, P. R. China

Lab of test: Hefei General Machinery & Electrical Products Inspection Institute

Test Date: August 24, 2017

Description of valves: AB-8-T22-150-RF-01-C-R-W-C Ball Valve

Size: 8"

Pressure Rating: Class 150

Drawing No.: 10020604 VER. 1.0

Test Witnessed By: CHEN Guilin / TÜV SÜD Inspector




Test Report No. : 253300 Rev.1

## Inspection and Tests

### 1. Conformity of Equipment

The test equipment was verified by TÜV SÜD inspector according to requirements of API STANDARD 607 SEVENTH EDITION, JUNE 2016. Para.5.3 and found satisfactory. The detail arrangement of the fire-test equipment is shown below:

**Figure 1. Typical Fire-Test System Using Compressed Gas as the Pressure Source**

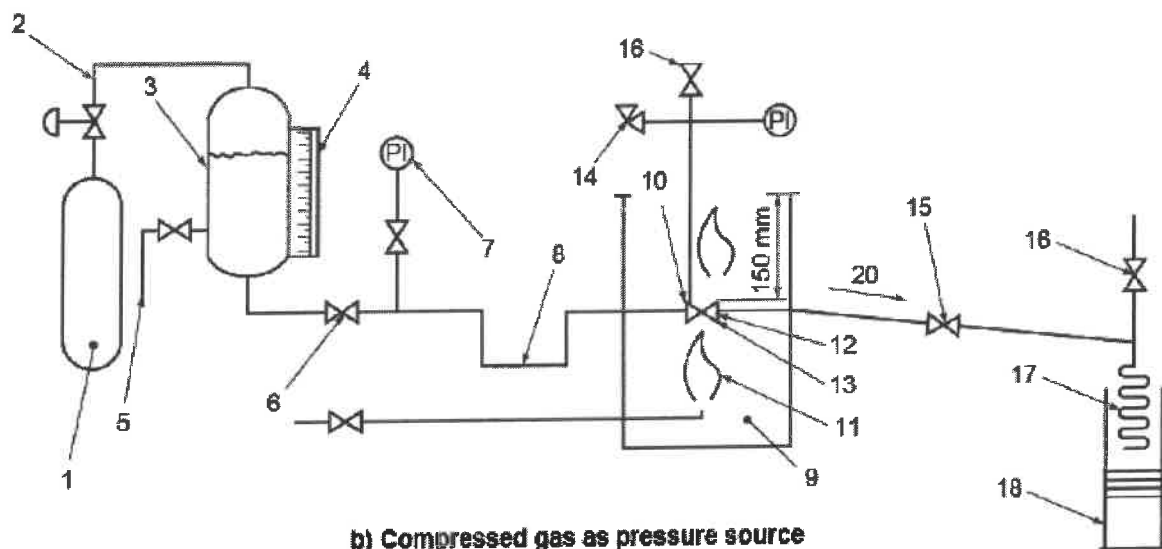

### Key

- |                                  |  |                       |
|----------------------------------|--|-----------------------|
| 1. Pressure source               | 10. Test valve mounted horizontally                      | 19. Check valve       |
| 2. Pressure regulator and relief | with stem in horizontal position (see 5.6.1)             | 20. Slope             |
| 3. Vessel for water              | 11. Fuel gas supply and burner                           | 21. Clearance: 150 mm |
| (6in.)                           |  |                       |
| 4. Calibrated sight gauge        | 12. Calorimeter cubes (see 5.3.2)                        |                       |
| 5. Water supply                  | 13. Flame environment and body thermocouples (see 5.3.2) |                       |
| 6. Shut-off valve                | 14. Pressure gauge and relief valve (see 5.3.2)          |                       |
| 7. Pressure gauge                | 15. Shut-off valve                                       |                       |
| 8. Piping arranged to            | 16. Vent valve   |                       |
| provide vapor trap (see 5.3.2)   | 17. Condenser  |                       |
| 9. Enclosure for test            | 18. Container (see 5.3.2)                                |                       |





**Test Report No.:253300 Rev.1**

**2. Calibration of measurement and test instrument**

The measurement and test instrument have been properly calibrated such as pressure gauges, thermocouples, etc.

**3. Technical Data of Test Valve:**

**a) Description of test valve**

Type of Test Valves	AB-8-T22-150-RF-01-C-12-W-C Ball Valve
Description of Valves	Ball Valve
Pressure Class	Class 150
Valve Size	8"
Face to Face	ASME B16.10
Designed Standard	API6D

**b) Details of technical data on test valve**

Part Name	Materials
Valve Body	ASTM A105
Valve Bonnet	ASTM A105
Ball	ASTM A182 F316
Seat assembly	ASTM A182 F316+RPTFE
Valve Stem	ASTM A564 630
Packing Ring	Flexible Graphite
Pressure Ring	ASTM A376 316
Nut	ASTM A194 2H
Bolt	ASTM A193 B7
Gasket	Flexilble Graphite
Yoke	Q235
Locating Sleeve	PTFE+Flexilble Graphite
Disc Sping	ASTM A564 631
Stuffing Box	ASTM A105
Couping	ASTM A182 F6a
Graphite Ring	Flexilble Graphite
Design Drawing No.:	10020604 VER.1.0





**Test Report No.:253300 Rev.1**

**4. Visual and dimensional Check on Valve Specimen:**

The specimen valve was chosen at random by the manufacturer in its workshop and submitted to the laboratory. The visual and dimensional check was performed according to drawing No. 10020604 VER. 1.0 and results found satisfactory. The mark was verified on valve as following:

	<u>8"</u>	<u>150</u>	<u>A105</u>
Manufacturer` Brand	Size	Class	Material

The sample valve was equipped with a worm gearbox.

**5. Document Review:**

The chemical and mechanical test report of forgings was reviewed and found satisfactory. Also the inspection report of shell test, hydro seat test and air seat test were reviewed and found satisfactory.

**6. Preparation before testing:**

**6.1 The thermocouples and calorimeters were installed properly according to Figure 1,2,3,4 in API 607.**

Two thermocouples (part 13) are installed to measure flame temperature, one is located under valve body, another is located under valve stem, both within 1". Two calorimeters (part 12) are positioned to the same place as the thermocouples do, and a third one is positioned nearby the bottom cover.

**6.2 The test system including test valve (part 10) was cleaned through by water before testing. All air was purged from test valve and testing system by water.**

**6.3 The test system was pressurized to 2.8 MPa after the test valve and system upstream of valve have been completely full of water and system downstream of the test valve have been completely empty of water. The system and test valve were carefully checked for leakage when the test pressure was held at 2.8 MPa. No leakage was found on system and test valve.**

**7. Fire Test:**

The fire test was conducted according to API STANDARD 607 SEVENTH EDITION, JUNE 2016. Section 5. The pressure of the system upstream was kept 0.2 MPa, then the fire ignited. The flame temperature reached 750°C within 2 minutes after ignition. The test pressure and temperature were maintained at 0.2 MPa during the fire test. The temperature and pressure were recorded continuously by the operators. The system and test valve was cooled at 30°C within 8 minutes by shower nozzles after 30 minutes fire test. The loss of water weight in vessel was measured by weighing scale and water in calibrated container (part 18) were read and recorded. The test result is shown as below:



**Test Report No.:253300 Rev.1**

**Test result of fire test**

Item	API 607 Required Value	Actual Value
Test Pressure ( MPa )	0.2 MPa	0.195 – 0.205 MPa
Test Temperature	750 - 1000 °C	805.6 – 896.2°C
Through-valve leakage according to API 607 table 1	≤ 800 ml / minute	25.3 ml / minute
Total weight of water through valve seat during cooling down period	0 ml	
Total time from fire test to cooling down	38 Minutes	
External Leakage	≤ 200 ml / minute	1.7 ml / minute
Conclusion: the test result is satisfactory according to API 607.		

**8. Low Test:**

The test valve was cooled at 30 °C within 8 minutes after complete the fire test. The low pressure test was conducted according to API STANDARD 607 SEVENTH EDITION, JUNE 2016.Para. 6.4 and 5.6.15. The test result was recorded as below:

**Test result of low pressure test**

Item	API 607 Required Value	Actual Value
Test Pressure ( MPa )	0.2 MPa	0.2 MPa
Test Temperature	30 °C	
Test Time	5 minutes	
External Leakage	≤ 320 ml / minute	2.4 ml / minute
Conclusion: the test result is satisfactory according to API 607.		

**9. Operational Test:**

The test valve was cooled at 30 °C within 8 minutes after complete the fire test. The operational test was conducted according to API STANDARD 607 SEVENTH EDITION, JUNE 2016.Para. 6.6 and 5.6.17. The upstream pressure was increased to 1.5MPa then the test valve was fully opened against the high test pressure differential to vent the piping and test valve body cavity to remove air or steam. The downstream shutoff valve was then closed and the system pressure was increased to and maintained at 1.5MPa. Then measured and recorded external leakage for a period of five minutes after valve was in the open position at high test pressure. The test result was recorded as below:

**Test result of operational test**

Item	API 607 Required Value	Actual Value
Test Pressure ( MPa )	1.5 MPa	1.5 MPa
Test Temperature	30 °C	
Test Time	5 minutes	
External Leakage	≤ 200 ml / minute	1.2 ml / minute
Conclusion: the test result is satisfactory according to API 607.		



**Test Report No.: 253300 Rev.1**

The undersigned, hereby declare that I have checked test valve and witnessed the fire test on the test valve according to API STANDARD 607 SEVENTH EDITION, JUNE 2016. The test result is satisfactory.

TÜV SÜD Industrie Service GmbH



CHEN Guilin

Date: July 21, 2022

**Annexes:**

- 1) Copy of Drawing No. 10020604 VER. 1.0;
- 2) Copy of Test Record of Fire Test No. 2017FM664.

