



CERTIFICATE

(Certificate of conformity with technical requirements in:)
API STANDARD 607 EIGHTH EDITION, OCTOBER 2022

Certificate No.: 315827

Ref. Test report No.: 315828

Name and postal address of manufacturer: **Antiwear (Suzhou) Industrial Intelligent Technology Co., Ltd.**
No.988, Yuexiu Road, Fenu Economic Development Zone, PC: 215200, Suzhou City, Jiangsu Province, P. R. China

We hereby certify that the fire test on below valves have been conducted at the laboratory designated by manufacturer and witnessed by TÜV SÜD inspector according to requirements of API STANDARD 607 EIGHTH EDITION, OCTOBER 2022. The testing results of valves meet the requirements of API STANDARD 607 EIGHTH EDITION, OCTOBER 2022.

1. Description of Test Valve:

Type of Test Valve	MSB-T2-900-2-RF-NN Ball Valve
Description of Test Valve	Ball Valve
Valve Size (NPS)	2"
Pressure Rating (Class)	Class 900
Valve Body Material	ASTM A351 CF8

2. Qualified Range of Valves :

Type	Ball Valves
Description of Valves	Ball Valves
Qualified Sizes (NPS) (according to API 607 Table 3)	2" and below, 2 1/2", 3", 4"
Qualified Pressure Ratings(Class) (according to API 607 Table 4)	Class 900, Class 1500
Qualified Valve Material	According to API 607 7.2
Remark: the technical data of tested valves see back of this certificate appendix 1.	

This certificate is issued according to API STANDARD 607 EIGHTH EDITION, OCTOBER 2022, based upon the result of testing report on above mentioned test valve. The additional valve qualification shall be limited on similar valves of same basic design and construction as the test valves and of the same nonmetallic materials as the test valve in the seat-to-closure member seal, seat-to-body seal, stem seal, and body joint seal according to API STANDARD 607 EIGHTH EDITION, OCTOBER 2022, Paragraph 7.

Shanghai, December 08, 2024
(Place, date)

Chen

Guilin Chen



TÜV SÜD Certification and Testing (China) Co., Ltd.
Floor 3-13, No.151, Heng Tong Road,
Shanghai, 200070, P. R. China



Appendix 1:

Certificate No.: 315827

Ref. Test report No.: 315828

Name and postal address of manufacturer: Antiwear (Suzhou) Industrial Intelligent Technology Co., Ltd.
No.988, Yuexiu Road, Fenu Economic Development Zone, PC: 215200, Suzhou City, Jiangsu Province, P. R. China

Technical Data of Valve

1. Type of Test Valve: MSB-T2-900-2-RF-NN Ball Valve

2. Description of Test Valve: Ball Valve

3. Details of Valve:

Valves Size (NPS) Material Part Name	2"
Body	ASTM A351 CF8
Bonnet	ASTM A351 CF8
Bottom Cover	ASTM A182 F316L
Stem	630+G14
Lower Stem	630+G14
Ball	ASTM A182 F51+G06
Gasket	316L+ Flexible Graphite
Seal Ring	Flexible Graphite
Packing	Flexible Graphite
Seat	ASTM A182 F51+G05+G50
O-Ring	V0390N
Yoke	ASTM A351 CF8
Nut	ASTM A194 8
Bolt	ASTM A193 B8 CL2
Packing Box	ASTM A182 F316L
Design Assembly Drawing No.:	MSBBJ-2F9RF-C-ZJ-X6-D-155 Rev.A1

Shanghai, December 08, 2024

(Place, date)




Guilin Chen

TÜV SÜD Certification and Testing (China) Co., Ltd.
Floor 3-13, No.151, Heng Tong Road,
Shanghai, 200070, P. R. China

TÜV SÜD Certification and Testing (China) Co., Ltd.
Shanghai Branch
Floor 3-13, No.151, Heng Tong Road,
Shanghai, 200070, P. R. China

Tel.: +86(0) 21 6141 0123
Fax: +86(0) 21 6140 8600
Internet: www.tuvsud.cn



Test Report

(Fire test for valves according to API STANDARD 607 API STANDARD 607 EIGHTH EDITION, OCTOBER 2022.)

Certificate No. : 315827
Test Report No.: 315828

Applicant / Manufacturer: Antiwear (Suzhou) Industrial Intelligent Technology Co., Ltd.

No.988, Yuxiu Road, Fenu Economic Development Zone,

PC: 215200, Suzhou City, Jiangsu Province, P. R. China

Inspection body: TÜV SÜD Industrie Service GmbH

Floor 3-13, No.151, Heng Tong Road, Shanghai, P. R. China

Lab of test: Hefei General Machinery & Electrical Products Inspection Institute

Test Date: November 26, 2024

Description of valves: MSB-T2-900-2-RF-NN Ball Valve

Size: 2"

Pressure Rating: Class 900

Assembly Drawing No.: MSBBJ-2F9RF-C-ZJ-X6-D-155 Rev.A1

Test Witnessed By: Chen Guilin / TÜV SÜD Inspector


Test Report No.: 315828

Inspection and Tests

1. Conformity of Equipment

The test equipment was verified by TÜV SÜD inspector according to requirements of API STANDARD 607 EIGHTH EDITION, OCTOBER 2022. Para.5.3 and found satisfactory. The detail arrangement of the fire-test equipment is shown below:

Figure 1. Typical Fire-Test System Using a Pump as the Pressure Source

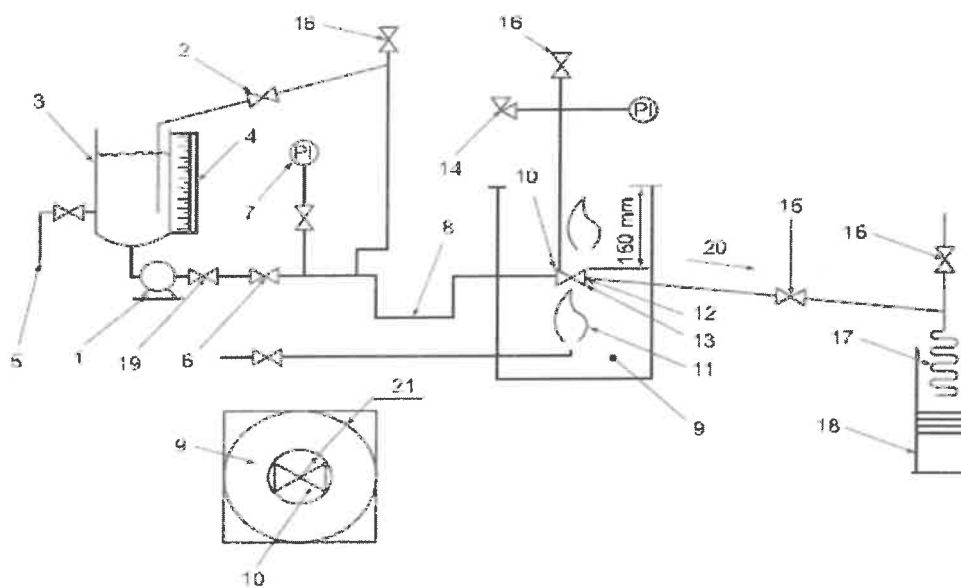

a) Pump as pressure source

Key

- | | | |
|--|--|-----------------------|
| 1. Pressure source | 10. Test valve mounted horizontally with stem in horizontal position | 19. Check valve |
| 2. Pressure regulator and relief | | 20. Slope |
| 3. Vessel for water | 11. Fuel gas supply and burner | 21. Clearance: 150 mm |
| 4. Calibrated sight gauge | 12. Calorimeter cubes | |
| 5. Water supply | 13. Flame environment and body thermocouples | |
| 6. Shut-off valve | 14. Pressure gauge and relief valve | |
| 7. Pressure gauge | 15. Shut-off valve | |
| 8. Piping arranged to provide vapor trap | 16. Vent valve | |
| 9. Enclosure for test | 17. Condenser | |
| | 18. Container | |



Test Report No.: 315828

2. Calibration of measurement and test instrument

The measurement and test instrument have been properly calibrated such as pressure gauges, thermocouples, etc.

3. Technical Data of Test Valve:

a) Description of test valve

Type of Test Valves	MSB-T2-900-2-RF-NN Ball Valve
Description of Valves	Ball Valve
Pressure Class	Class 900
Valve Size	2"
Flange Connection	ASME B16.5
Designed Standard	ASME B16.34

b) Details of technical data on test valve


Part Name	Materials
Body	ASTM A351 CF8
Bonnet	ASTM A351 CF8
Bottom Cover	ASTM A182 F316L
Stem	630+G14
Lower Stem	630+G14
Ball	ASTM A182 F51+G06
Gasket	316L+ Flexible Graphite
Seal Ring	Flexible Graphite
Packing	Flexible Graphite
Seat	ASTM A182 F51+G05+G50
O-Ring	V0390N
Yoke	ASTM A351 CF8
Nut	ASTM A194 8
Bolt	ASTM A193 B8 CL2
Packing Box	ASTM A182 F316L
Design Assembly Drawing No.:	MSBBJ-2F9RF-C-ZJ-X6-D-155 Rev.A1



Test Report No.: 315828

4. Visual and dimensional Check on Valve Specimen:

The specimen valve was chosen at random by the manufacturer in its workshop and submitted to the laboratory. The visual and dimensional check was performed according to drawing No. WTJ0855F2S3DAIR1SXWDQ and results found satisfactory. The mark was verified on valve as following:

	<u>2"</u>	<u>900</u>	<u>CF8</u>
Manufacturer` Brand	Size	Class	Material

5. Document Review:

The chemical and mechanical test report of castings was reviewed and found satisfactory. Also the inspection report of shell test, hydro seat test and air seat test were reviewed and found satisfactory.

6. Preparation before testing:

- 6.1 The thermocouples and calorimeters were installed properly according to Figure 1,2,3,4 in API 607. Two thermocouples (part 13) are installed to measure flame temperature, one is located under valve body, another is located under valve stem, both within 25mm. Two calorimeters (part 12) are positioned to the same place as the thermocouples do.
- 6.2 The test system including test valve (part 10) was cleaned through by water before testing. All air was purged from test valve and testing system by water.
- 6.3 The test system was pressurized to 20.8 MPa after the test valve and system upstream of valve have been completely full of water and system downstream of the test valve have been completely empty of water. The system and test valve were carefully checked for leakage when the test pressure was held at 20.8 MPa. No leakage was found on system and test valve.

7. Fire Test:

The fire test was conducted according to API STANDARD 607 EIGHTH EDITION, OCTOBER 2022 Section 5. The pressure of the system upstream was kept 11.2 MPa, then the fire ignited. The flame temperature reached 750°C within 2 minutes after ignition. The test pressure and temperature were maintained at 11.2 MPa during the fire test. The temperature and pressure were recorded continuously by the operators. The system and test valve was cooled below 100 °C within 5 minutes by shower nozzles after 30 minutes fire test. The loss of water weight in vessel was measured by weighing scale and water in calibrated container (part 18) were read and recorded. The test result is shown as below:



Test Report No.: 315828

Test result of fire test

Item	API 607 Required Value	Actual Value
Test Pressure (MPa)	11.2 MPa	10.83-11.98 MPa
Test Temperature	750 - 1000 °C	816.8 – 871.0°C
Through-valve leakage according to API 607 table 1	≤ 800 ml / minute	49.0 ml / minute
Total weight of water through valve seat during cooling down period	0 ml	
Total time from fire test to cooling down	35 Minutes	
External Leakage	≤ 200 ml / minute	10.5 ml / minute
Conclusion: the test result is satisfactory according to API 607.		

8. Operational Test:

The test valve was cooled below 100 °C within 5 minutes after complete the fire test. The operational test was conducted according to API STANDARD 607 EIGHTH EDITION, OCTOBER 2022 Para. 6.6 and 5.6.17. The upstream pressure was increased to 11.2 MPa then the test valve was fully opened against the high test pressure differential to vent the piping and test valve body cavity to remove air or steam. The downstream shutoff valve was then closed and the system pressure was increased to and maintained at 11.2 MPa. Then measured and recorded external leakage for a period of five minutes after valve was in the open position at high test pressure. The test result was recorded as below:

Test result of operational test

Item	API 607 Required Value	Actual Value
Test Pressure (MPa)	11.2 MPa	11.2 MPa
Test Temperature	30 °C	
Test Time	5 minutes	
External Leakage	≤ 50 ml / minute	35.6 ml / minute
Conclusion: the test result is satisfactory according to API 607.		

The undersigned, hereby declare that I have checked test valve and witnessed the fire test on the test valve according to API STANDARD 607 EIGHTH EDITION, OCTOBER 2022. The test result is satisfactory.

TÜV SÜD Certification and Testing (China) Co., Ltd. Shanghai Branch

RONG Zhibin
Prepared by: Rong Zhibin
Chen Guilin
Reviewed by: Chen Guilin

Date: December 08, 2024

Date: December 08, 2024

Annexes:

- Copy of Drawing No. MSBBJ-2F9RF-C-ZJ-X6-D-155 Rev.A1.
Copy of Test Record of Fire Test No. 2024FM1178.

性 能 范 围	
公称压力或压力级	Class 900
公称通径或口径	NPS 2
壳体试验压力(液体)	22.5MPa
密封试验压力(气体)	16.5MPa
密封试验压力(气体)	0.35MPa


- 技术要求
1. 阀门的设计与制造按照ASME B15.3.4的规定。
 2. 阀门的结构长度按照ASME B16.10的规定。
 3. 法兰连接尺寸按照ASME B16.5的规定。
 4. 阀门的试验与检验按照API 598的规定。
 5. 压力等级按照ASME B16.34。
 6. 阀门禁止脱脂处理。
 7. A类尺寸1个。

受控

TOV SÜD Certification and Testing (China) Co., Ltd.
Industry Service

☒ reviewed
☐ witnessed

by chen guolin
dated 2024-11-26

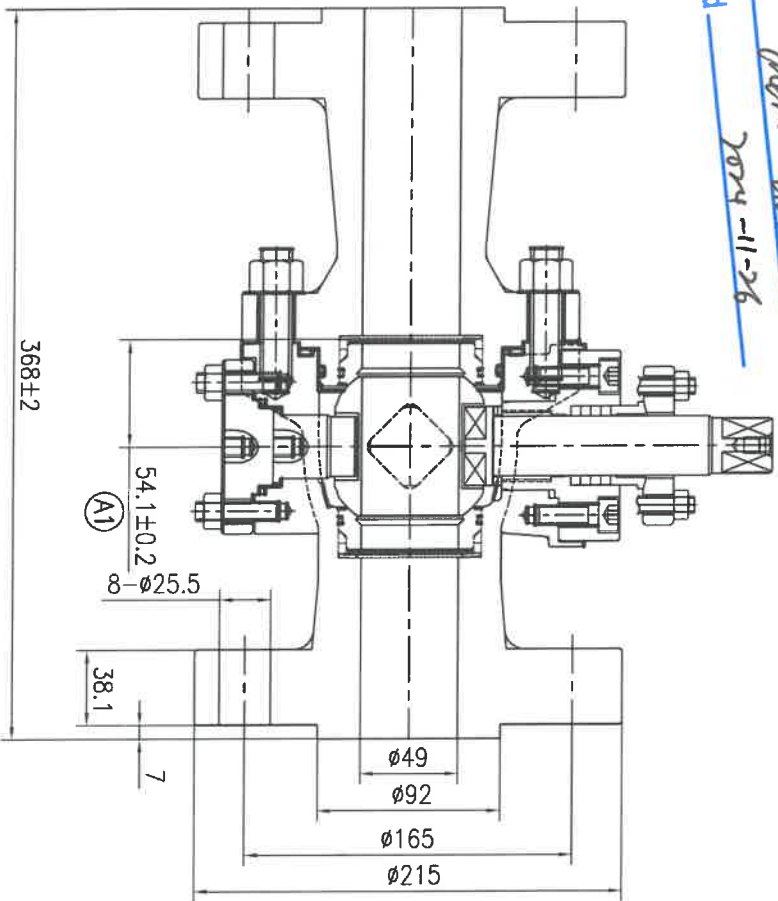

28	标准材料—GB/T1972-A16	4	A1	
27	螺母—GB/T6175-M8	4	A1	
26	全螺纹螺栓—GB/T901-M8x50	4	A1	
25	填料压套—30.5x44x18-X6	1	A1	
24	填料压板—33x60x15-YD-X6	1	A1	
23	盘根—30x40x5	2	A1	
22	石墨环—30x40x5	2	A1	
21	螺母—GB/T770.1-M10x30	4	A1	
20	填料圈—2G9Y-F-X6	1	A1	
19	石墨环—45x53x4	1	A1	
18	轴承—30x36x25-SD-X6	1	A1	
17	止推轴承—31x39.5x2-SD-X6	2	A1	
16	阀杆—24x30x33x155-0.8-PT-X6	1	A1	
15	填料—2G9Y-Q49-X6-B+圈—2G9Y-C-PIB-Q49-X6-D(+2)	1	A1	
14	压环—64x72x5-X6	2	A1	
13	螺母—71.5x53x1.5x3-X6	2	A1	
12	密封环—64x72x7-J45	2	A1	
11	填料圈—100x113x4.5	1	A1	
10	螺母—GB/T6175-M16	8	A1	
9	全螺纹螺栓—GB/T901-M16x65	8	A1	
8	阀帽—2F9RF-Q49-X6-D	1	A1	
7	阀体—2F9RF-Q49-X6-D	1	A1	
6	轴承—28x34x12-SD-X6	1	A1	
5	石墨环—40x48x4	1	A1	
4	螺母—GB/T6175-M10	4	A1	
3	全螺纹螺栓—GB/T901-M10x40	4	A1	
2	阀体—2G9Y-0.8-B+PT-X6	1	A1	
1	下盖—2G9Y-X6	1	A1	


序号	规格	数量	版本	备注
序号	更改文件号	签名	日期	
设计	张世英	校核	赵建敏	A1
审核	顾利君			
批准		日期	2021/3/16	比例 1:2.5

苏州安特威阀门有限公司

MSRBA-2F9RF-C-ZL-X6-D-155

MSBBJ-2F9RF-C-ZJ-X6-D-155物料清单

序列号	物料名称	物料编码	属性	材料
1.1.1.1	下盖-2G9Y-X6-F316L	1302080557	采购件	F316L
1.1.1.2	底轴-2G9Y-0.8-A+PT-X6-630+G14	1304010900	采购件	630+G14
1.1.1.3	全螺纹螺柱-GB/T901-M10x40-B8-2	1404020636	采购件	B8-2
1.1.1.4	螺母-GB/T6175-M10-A194-8	1404030040	采购件	A194-8
1.1.1.5	石墨环-40x48x4-柔性石墨	1405030858	采购件	柔性石墨
1.1.1.6	卷制轴承-30x34x12-SD-X6-316L+QPQ	1305120066	采购件	316L+QPQ
1.1.1.7	阀体-2F9RF-ZP-Q49-X6-D-CF8	1.3012E+11	制造件	CF8
1.1.1.8	阀帽-2F9RF-ZP-Q49-X6-D-CF8	1.30124E+11	制造件	CF8
1.1.1.9	全螺纹螺柱-GB/T901-M16x65-B8-2	1404020639	采购件	B8-2
1.1.1.10	螺母-GB/T6175-M16-A194-8	1404030020	采购件	A194-8
1.1.1.11	缠绕垫-100x113x4.5-316L+柔性石墨	1405040401	采购件	316L+柔性石墨
1.1.1.12	阀座-2G9Y-C-PHB-ZP-Q49-X6-D-F51+G05+G50	1303026164	委外加工件	F51+G05+G50
1.1.1.13	O型圈-GB/T3452.1-64.77x2.62-V0390N	1406011019	采购件	V0390N
1.1.1.14	密封环-64x72x9-J45-柔性石墨	1306020618	采购件	柔性石墨
1.1.1.15	碟簧-71.5x53x1.5x2.8-X7-631	1316040509	采购件	631
1.1.1.16	压环-64x72x5-X6-316	1303110450	采购件	316
1.1.1.17	球体-2G9Y-PHA-Q49-X6-B-F51+G06	1303011686	采购件	F51+G06
1.1.1.18	阀杆-24x30x33x155-0.8-PT-X6-630+G14	1304021120	采购件	630+G14
1.1.1.19	止推轴承-31x39.5x2-SD-X6-316+QPQ	1305070591	采购件	316+QPQ
1.1.1.20	卷制轴承-30x34x25-SD-X6-316L+QPQ	1305120035	采购件	316L+QPQ
1.1.1.21	石墨环-45x53x4-柔性石墨	1405030348	采购件	柔性石墨
1.1.1.22	填料函-2G9Y-E-X6-F316L	1305021126	采购件	F316L
1.1.1.23	螺钉-GB/T70.1-M10x30-B8-2	1404040267	采购件	B8-2
1.1.1.24	盘根-30x40x5-石墨盘根(易天地1374PR系列)	1405020281	采购件	石墨盘根(易天地1374PR系列)
1.1.1.25	填料压板-33x60x15-YD-X6-304	1305030321	采购件	304
1.1.1.26	填料压套-30.5x44x18-X6-304	1305040191	采购件	304
1.1.1.27	全螺纹螺柱-GB/T901-M8x50-B8-2	1404021063	采购件	B8-2
1.1.1.28	螺母-GB/T6175-M8-A194-8	1404030190	采购件	A194-8
1.1.1.29	标准碟簧-GB/T1972-A16-631	1408020139	采购件	631

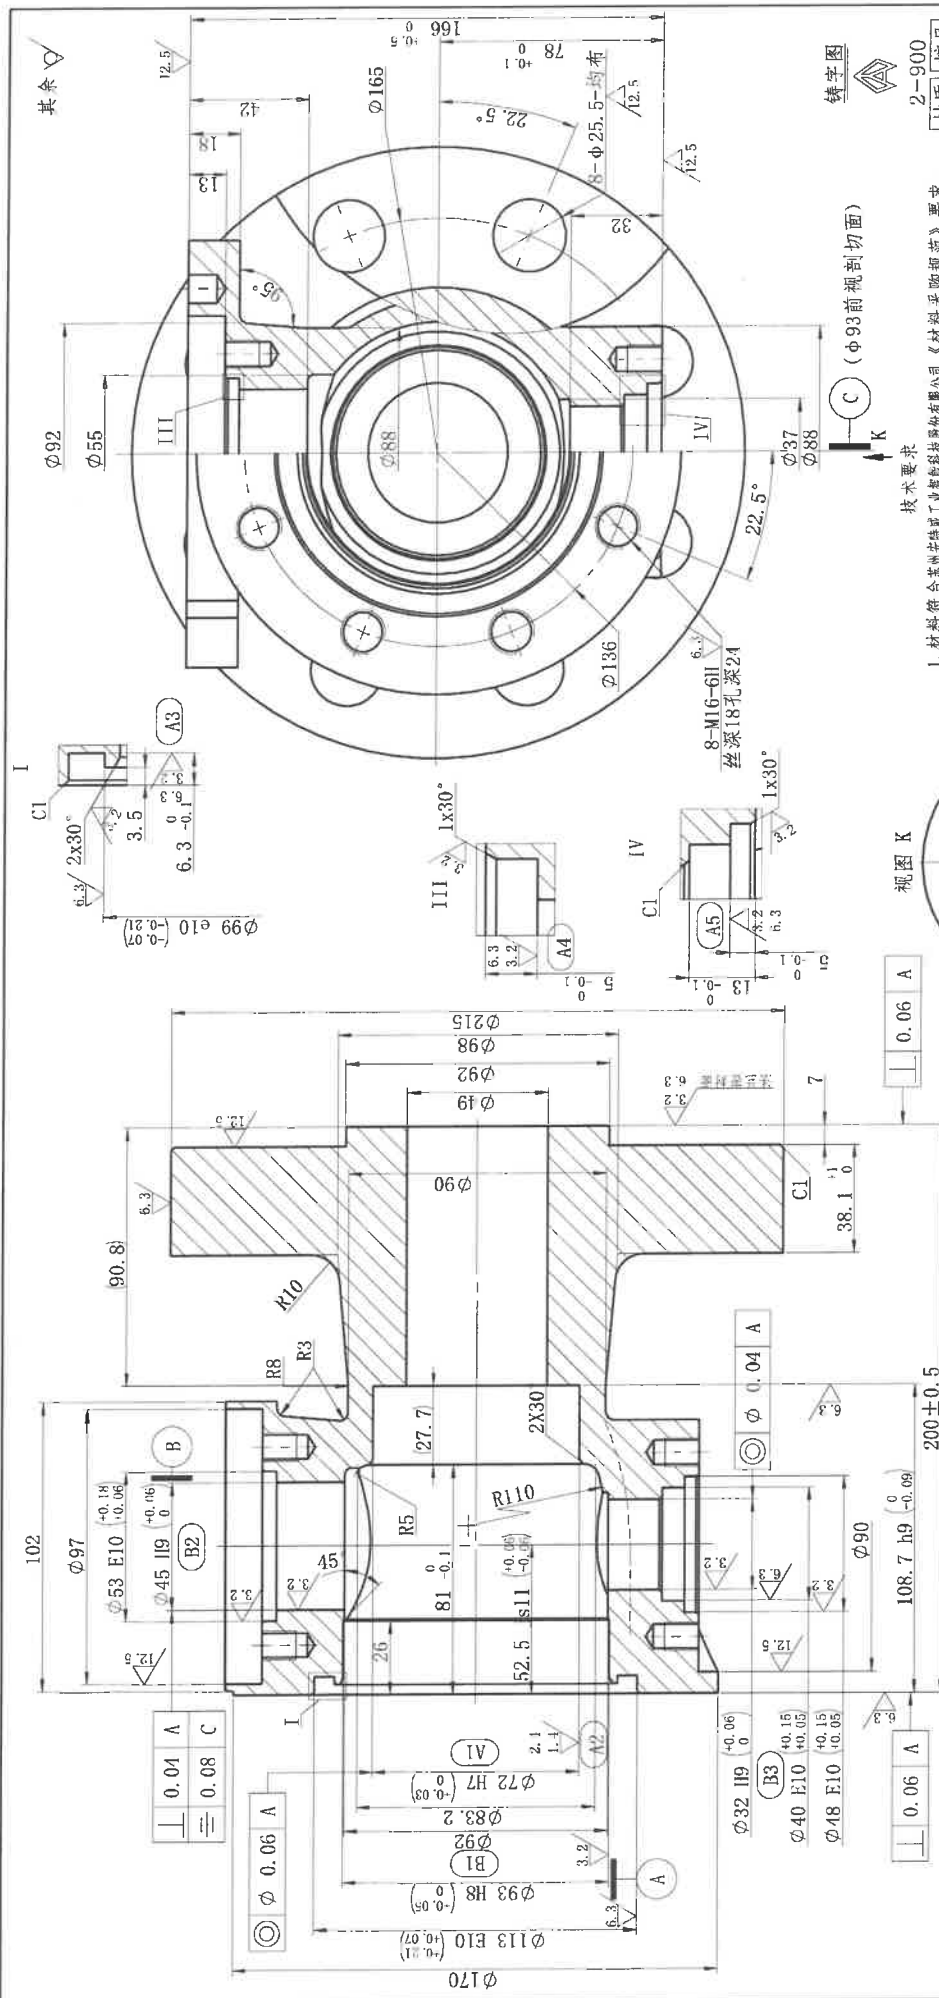


铸字图

2-900
材质 炉号

技术要求

1. 材料符合苏州安特威工业智能科技有限公司《材料采购规范》要求。
2. 铸件不应有影响强度和严密性的缩孔、砂眼、裂纹和疏松等缺陷。
3. 未注的铸造圆角为R2~R4。
4. 铸字符合苏州安特威工业智能科技有限公司《通用阀门铸字规范》要求。
5. TS标志符合《铸钢设备制造许可标志使用规范》。
6. 铸件表面进行抛丸处理，铸字清晰，表面质量符合MSS SP55的规定。
7. 阀体最小壁厚8mm，最小壁厚允许最大值为10mm。
8. 壳体试验22.5MPa，不允许有可见泄漏。
9. 加工面锐边倒钝，去毛刺。
10. A类尺寸5个，B类尺寸3个。
11. 加工尺寸未注公差尺寸的极限偏差按GB/T1804-m规定。
12. 加工尺寸未注公差尺寸的形位公差按GB/T1184-K规定。
13. 法兰密封面、炉号、端面打点等须符合安特威采购技术要求。

视图 K



受空



苏州安特威工业智能科技有限公司

序号	更改文件号	签名	日期
设计	王莹璐	校对	版次
审核	杨冲程	毛重	18.353kg
批准	蔡玉飞	日期	2024.8.6
		比例	1:1.8

阀体-2F9RF-ZP-Q49-X6-D

其余

端面打点，便于装配

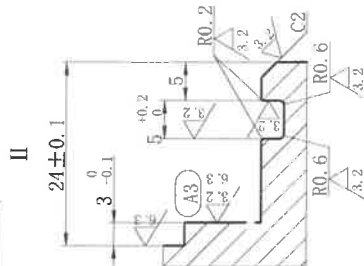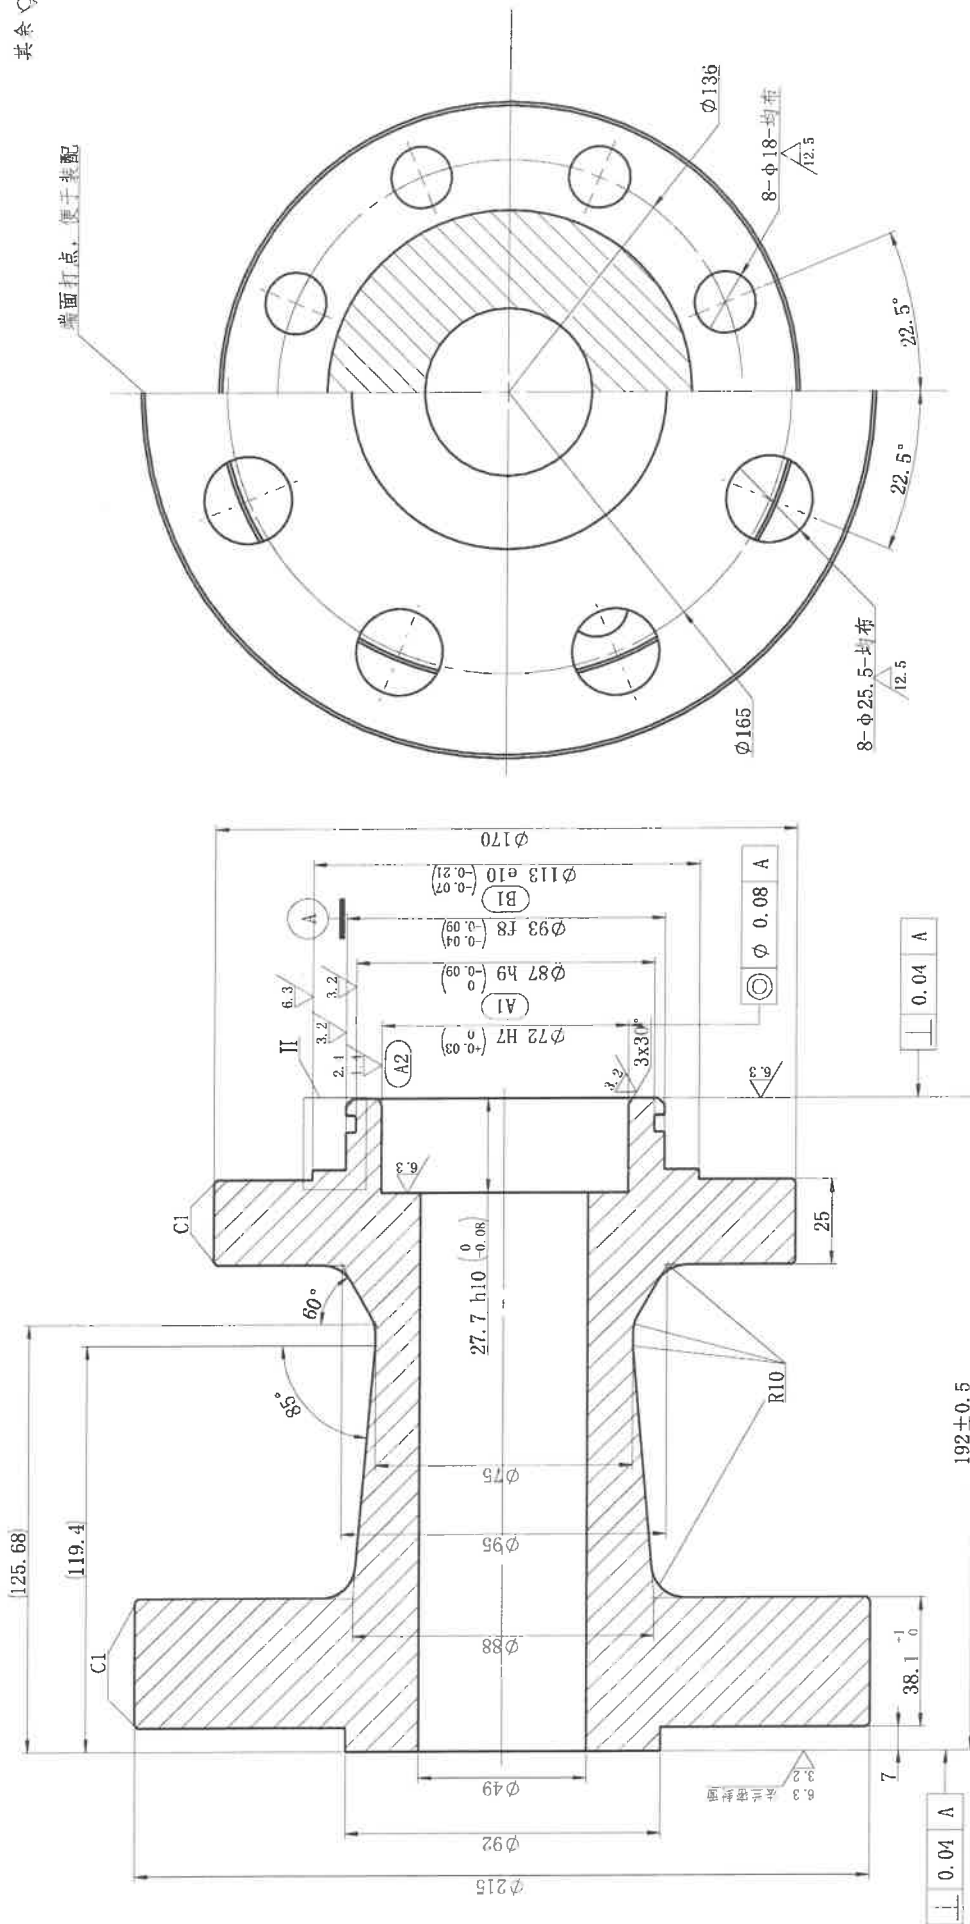

技术要求

- 材料符合苏州安特威阀门有限公司《材料采购规范》要求。
- 铸件不应有影响强度和密封性的缩孔、砂眼、裂纹和疏松等缺陷。
- 未注的铸造圆角为 $R2 \sim R4$ 。
- 铸件符合苏州安特威阀门有限公司《通用阀门 铸造规范》要求。
- TS标志符合《特种设备制造许可标志使用规范》。
- 铸件表面进行抛丸处理，铸件清晰，表面质量符合MSS SP55的规定。
- 阀瓣最小壁厚 8mm ，最小壁厚允许最大值为 10mm 。
- 壳体试验 22.5MPa ，不允许有可见泄漏。
- 加工面锐边倒钝，去毛刺。
- A类尺寸 3mm ，B类尺寸 1mm 。
- 加工尺寸未注公差尺寸的形位公差按GB/T1184-K规定。
- 加工尺寸未注公差尺寸的形位公差按GB/T1184-K规定。
- 法兰密封面、炉号、端面打点等须符合安特威采购技术要求。

铸字图

炉号

材质

炉号




苏州安特威阀门有限公司

序号	更改文件号	签名	日期
设计	王紫腾	董伟	版本
审核	杨树君	毛重	16.24kg
批准	黎玉飞	日期	2024/6/6
		比例	1:1.5

规格


阀座-219RF-21-49-X6-D

受控

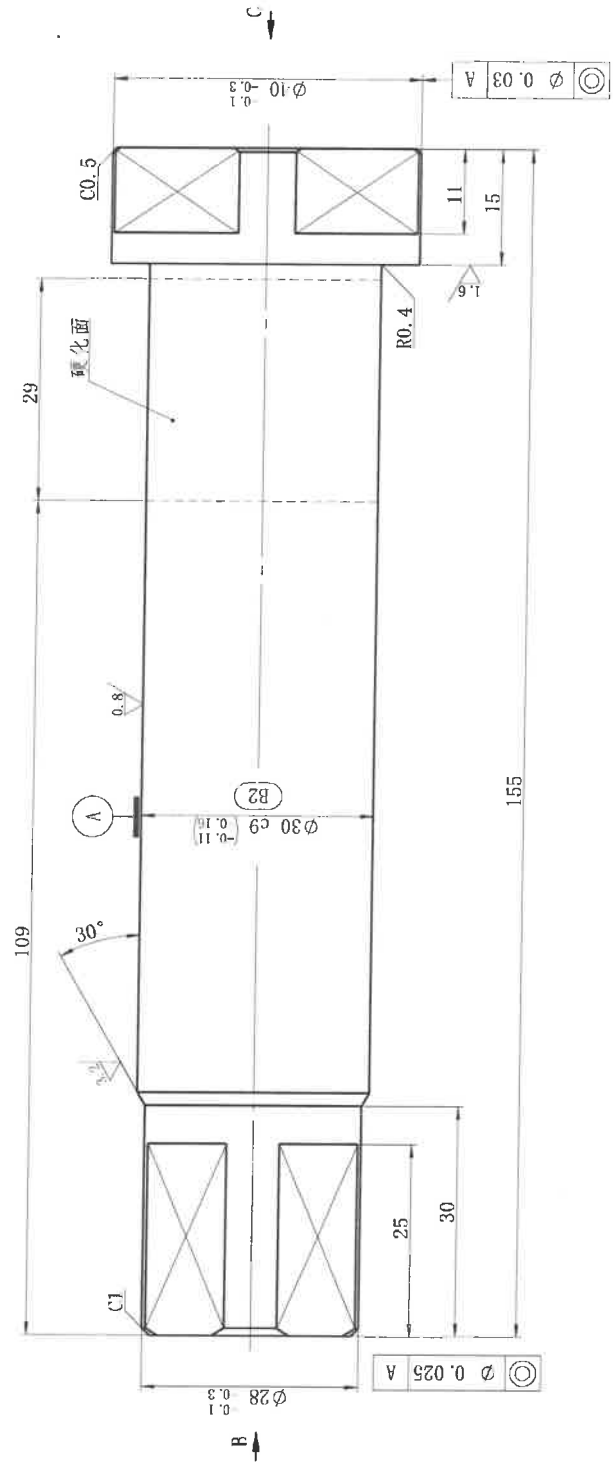

视图C

视图B

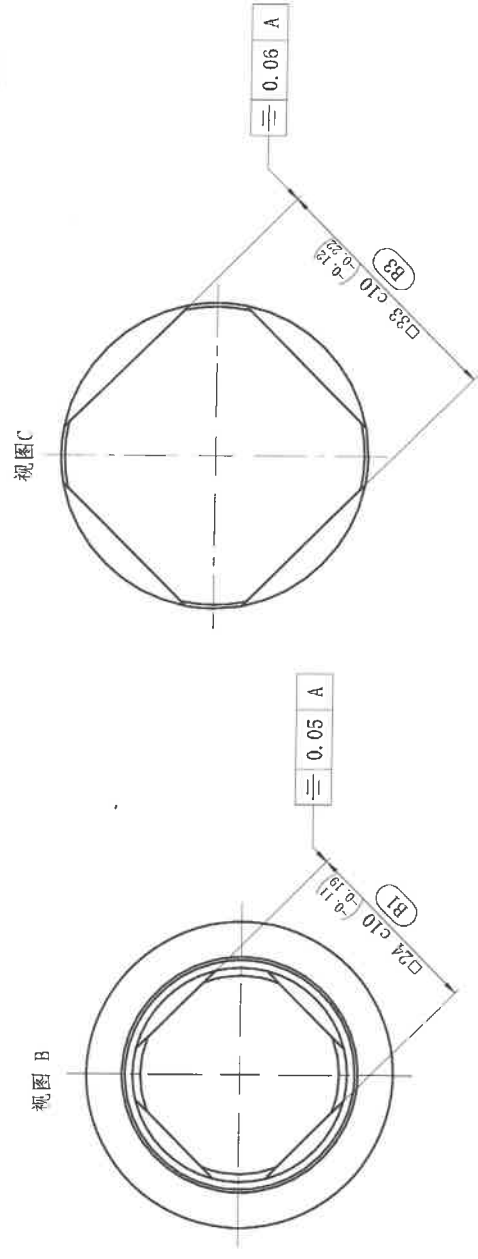

受控

技术要求

1. 材料符合苏州安特威阀门有限公司《材料采购规范》要求;
2. 喷涂硬质合金, 涂层硬度HRC≥65, 涂层表面不得有裂纹、划痕、脱落等现象, 喷涂表面之外的面在喷涂过程中需做好防护, 硬质层有效厚度≥0.15mm, 此图 为最终成形尺寸;
3. B类尺寸3个;
4. 加工面锐边倒钝, 去毛刺;
5. 加工尺寸未注公差尺寸的极限偏差按GB/T1804-m规定;
6. 加工尺寸未注公差尺寸的形位公差按GB/T1184-K规定。

ATV				苏州安特威阀门有限公司			
序号	更改文件号	签名	日期	设计	校对	审核	批准
	谷秋实	陈益标	版次	AI			
审核	陈树君	毛重	0.96kg	规格			
批准	黎玉飞	日期	2019/5/21	比例	1:1		
				阀门-2x3Dx33x55-0.6-DT-X6			

